

SHU LIGHTNING

CA-SHU-5594

as of 08/06/09 - 0550 Hrs


12,704 Acres 20% Contained

Started August 1, 2009 2100 Hrs

Expected Containment 8/8/09

Shasta County

12 hours: 230KV Power Generation infrastructure currently being impacted on Goose Branch. Major power generation lines have been de-energized. Large merchantable timber of high value threat on Goose and Chalk Branches. Continued structure and infrastructure threat on Cassel Branch. Pacific Crest Trail impacted.

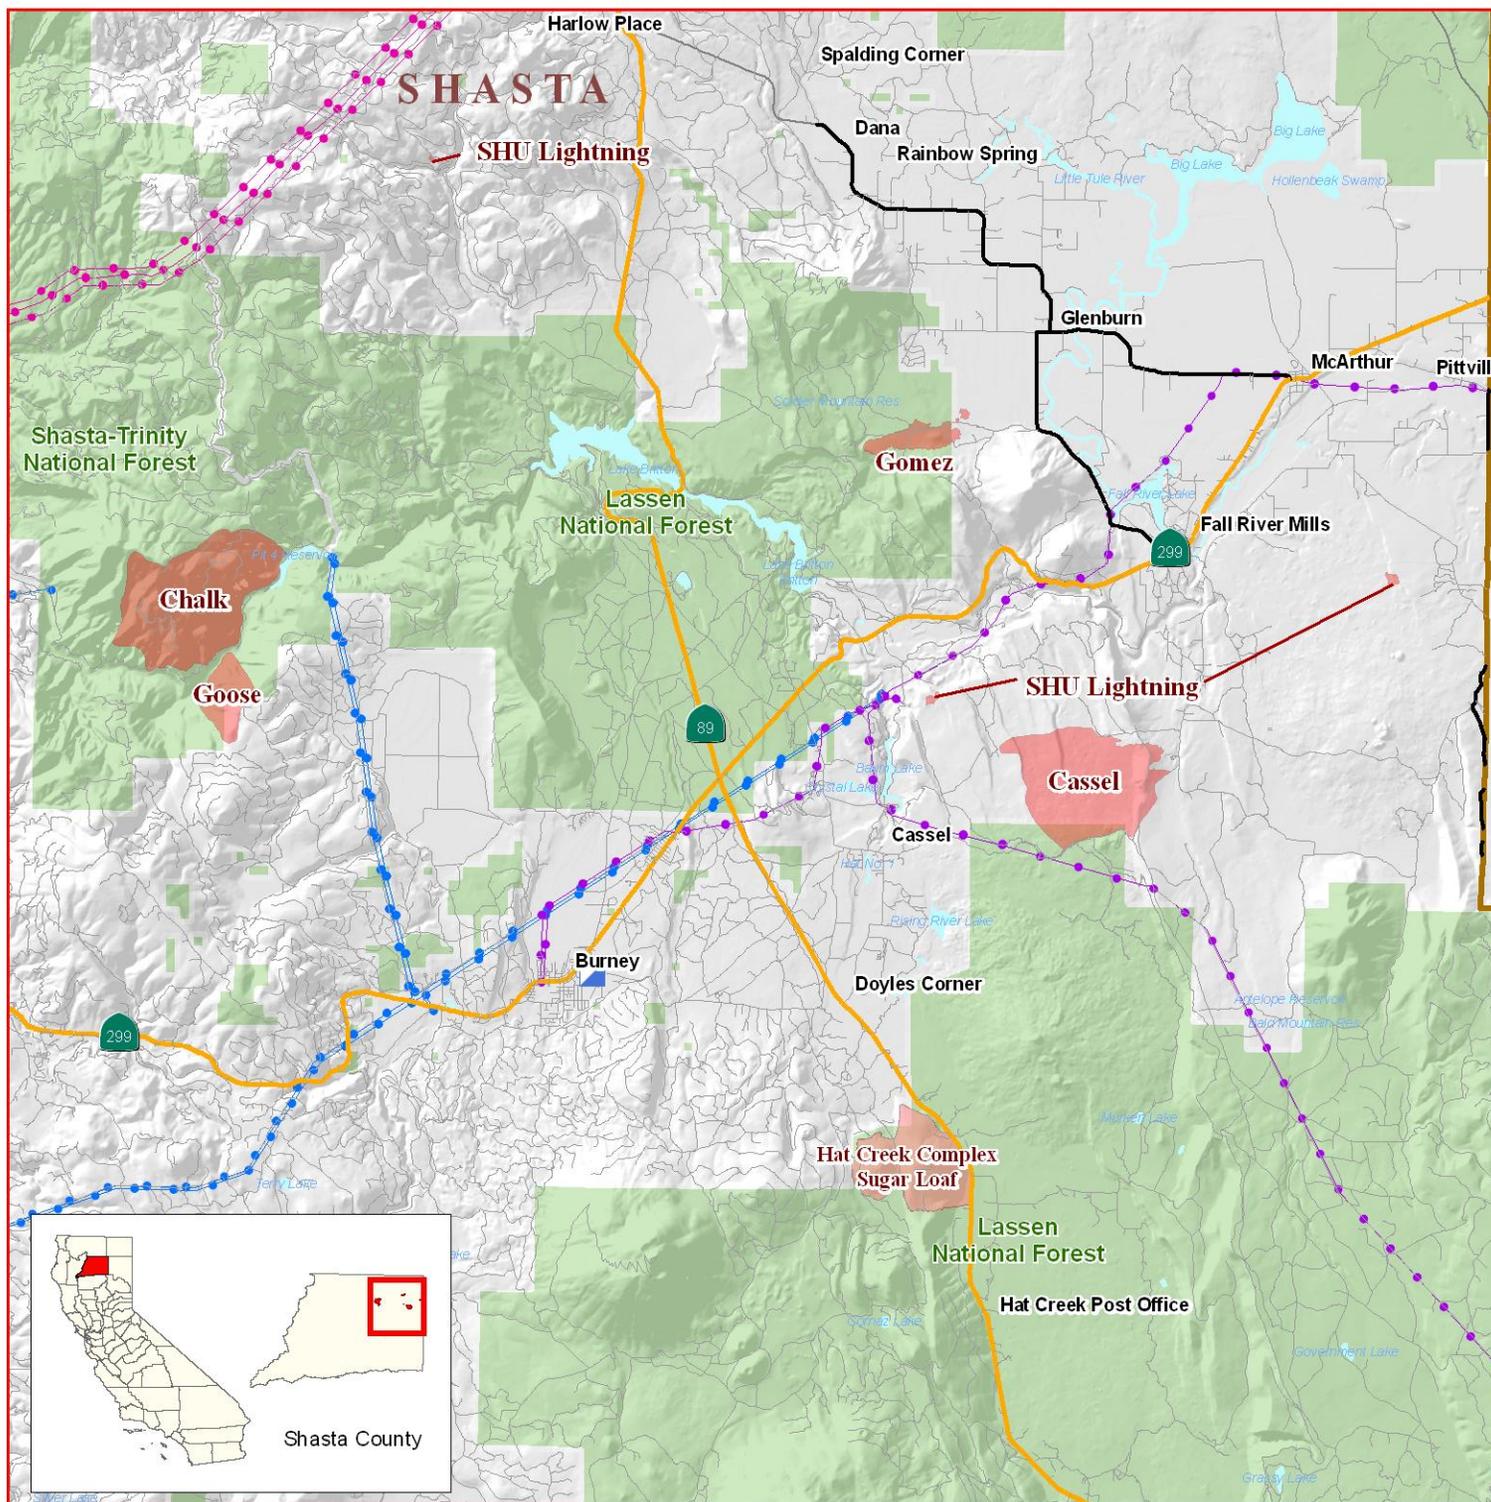

- SHU Lightning Complex
- Hat Creek Incident
- Incident Command Post
- Transportation Network**
 - Freeway
 - Highway
 - Primary
 - Secondary
 - Residential
- Transmission Line**
 - PGE - 230KV
 - PGE 60KV
 - 500KV
 - Forest



Created by CalEMA-GIS, Kris Higgs
August 6, 2009
Sources FAMWEB 2009s, Cal-Fire
active_incident/fires/2009/SHU_Lightning_CA-SHU_5594/
Projects/SHU_Lightning_080609_A.mxd

